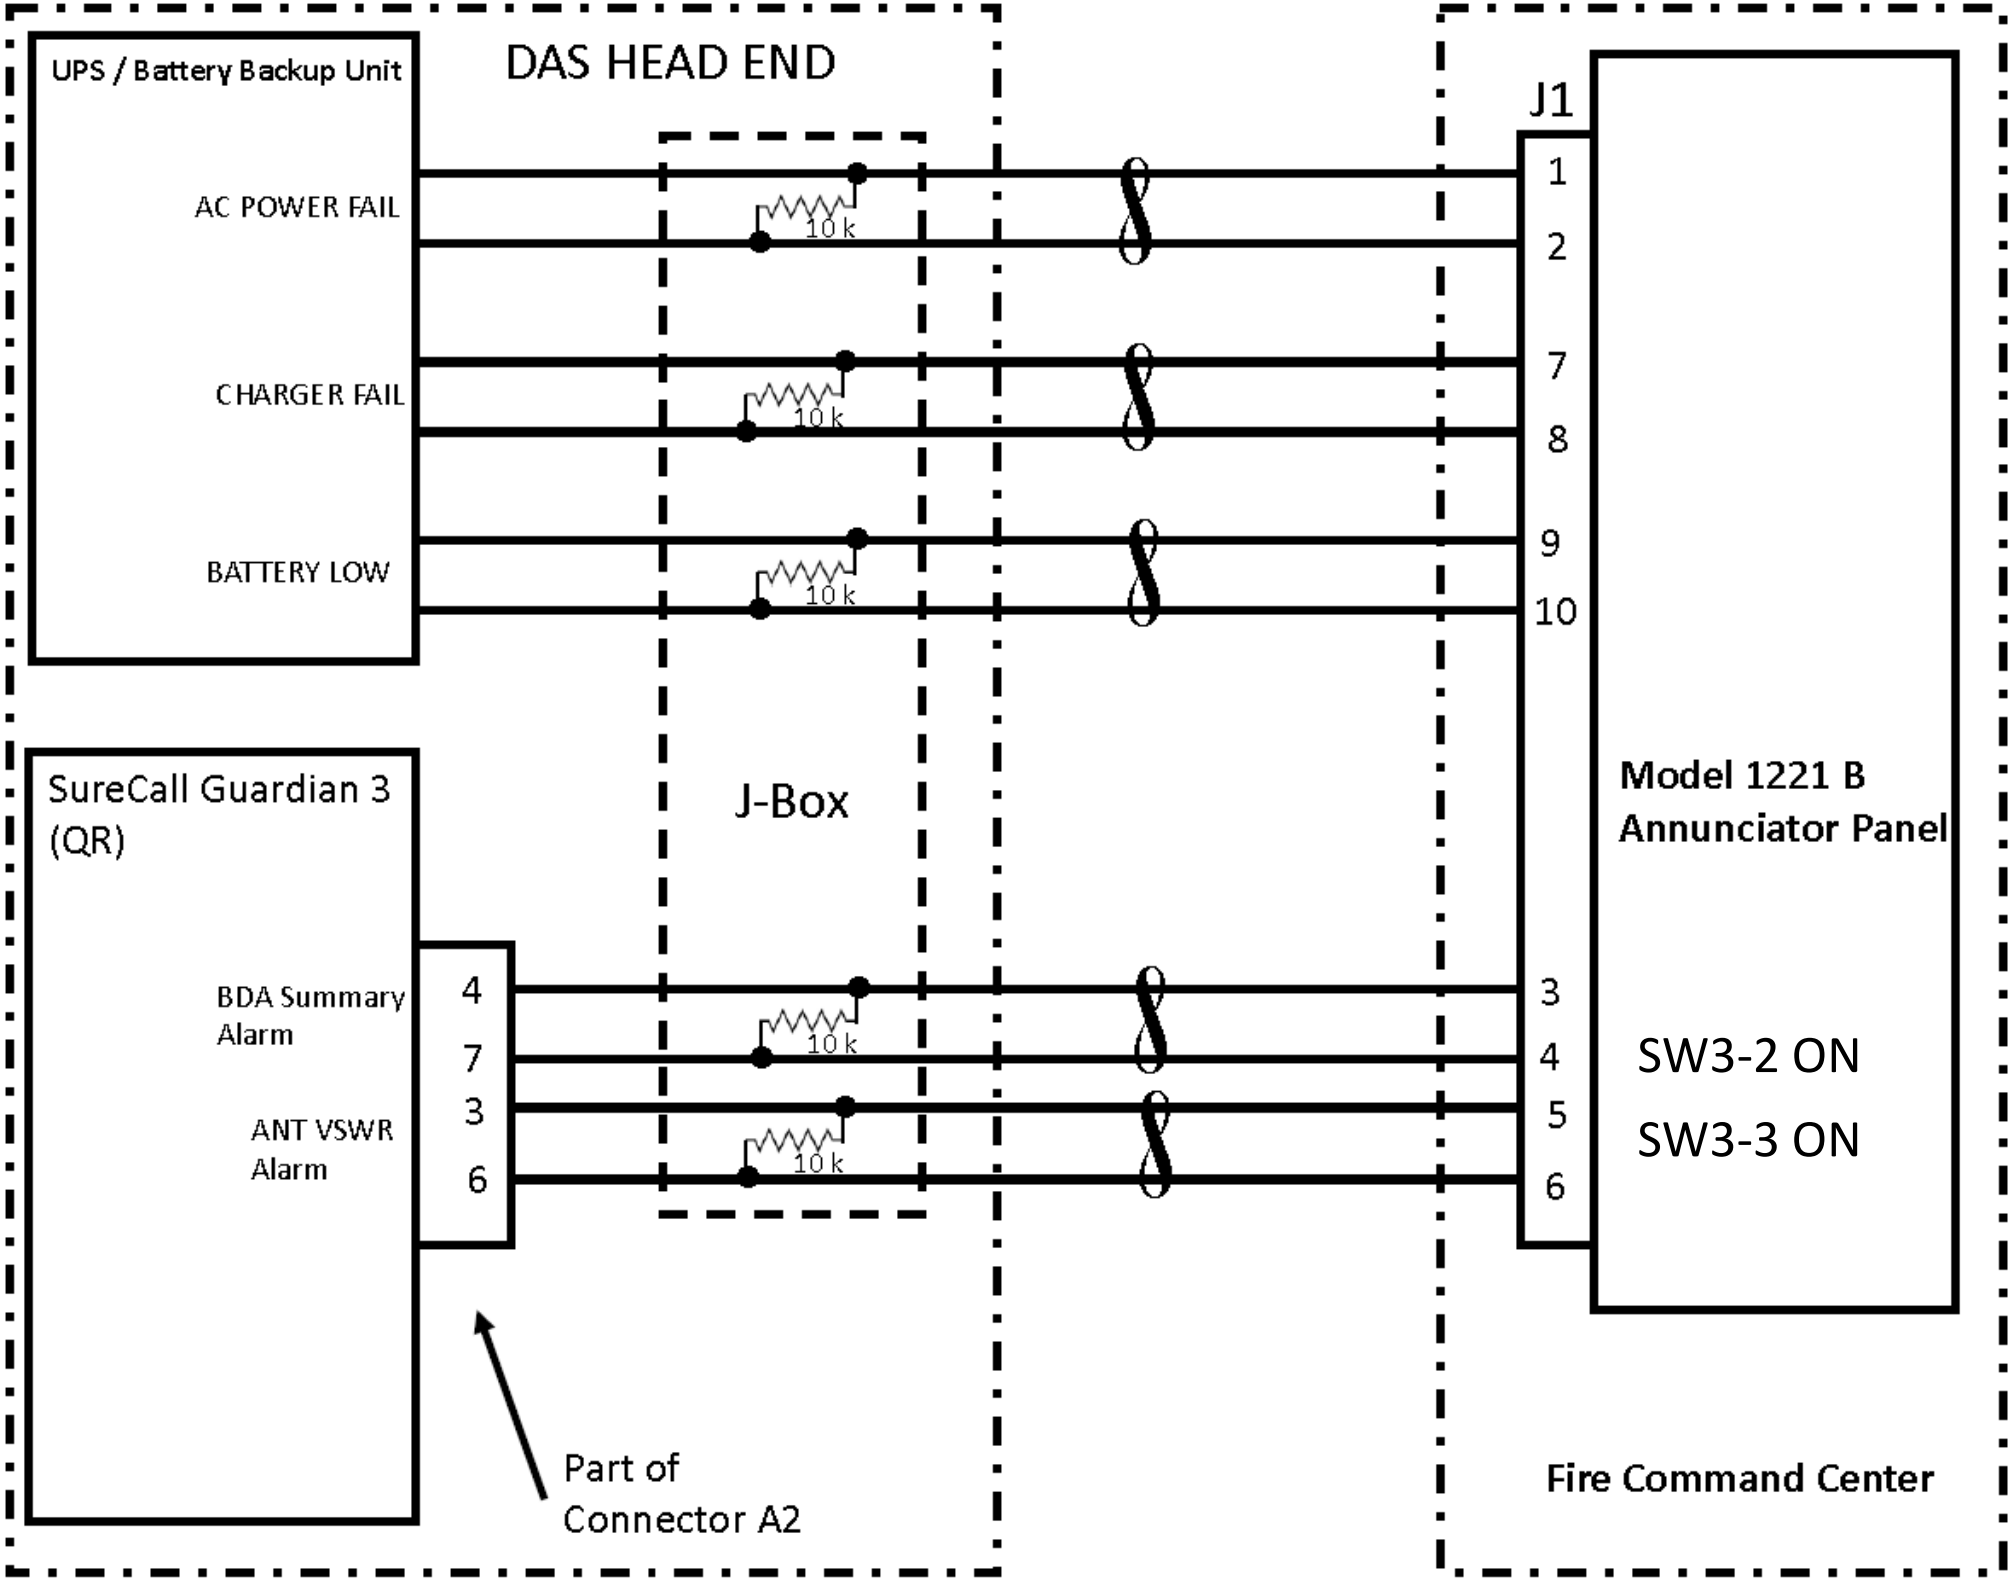
DAS HEAD END
UPS / Battery Backup Unit
AC POWER FAIL
CHARGER FAIL
BATTERY LOW
10 k
10 k
10 k
J-Box
SureCall Guardian 3
(QR)
BDA Summary
Alarm
ANT VSWR
Alarm
4
7
3
6
10 k
10 k
Part of
Connector A2
J1
1
2
7
8
9
10
3
4
5
6
Model 1221 B
Annunciator Panel
SW3-2 ON
SW3-3 ON
Fire Command Center